


ATTACHED SET OF INSTALLATION RULES L-9002B  
ACCOMPANY THIS DRAWING.

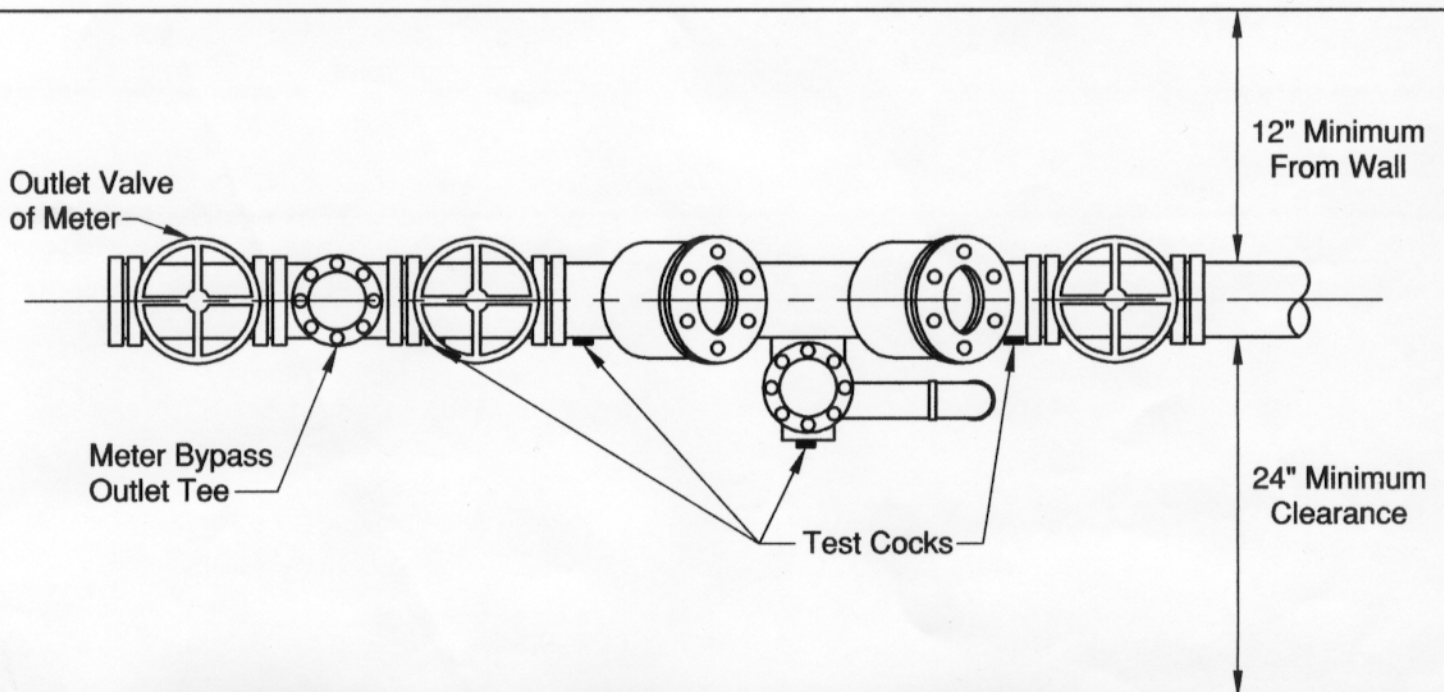

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:

ENGINEER

*Jeff Hubbard*

4/1/01  
DATE

STANDARD DETAIL  
BACKFLOW PREVENTER  
SETTING

FOR DOUBLE CHECK & REDUCED PRESSURE ASSEMBLIES

L-9002A